

# Low energy SWRO



## TM800V

Type	Diameter Inch	Membrane Area ft <sup>2</sup> (m <sup>2</sup> )	Salt Rejection %	Product Flow Rate gpd(m <sup>3</sup> / d)	Feed Spacer Thickness mil
TM810V	4"	87(8)	99.8	1,900(7.2)	28
TM820V-400	8"	400(37)	99.8	9,000(34.1)	34
TM820V-440	8"	440(41)	99.8	9,900(37.5)	28

1. Membrane Type		Cross Linked Fully Aromatic Polyamide Composite
2. Test Conditions	Feed Water Pressure Feed Water Temperature Feed Water Concentration Recovery Rate Feed Water pH	800 psi(5.52MPa) 77° F(25°C) 32,000 mg/l NaCl 8% 7
3. Minimum Salt Rejection		99.5%
4. Minimum Product Flow Rate		1,550gpd(5.9m <sup>3</sup> /d)(TM810V) 7,500gpd(28.4m <sup>3</sup> /d)(TM820V-400) 8,250gpd(31.2m <sup>3</sup> /d)(TM820V-440)
5. Boron Rejection (typical value)		92% at pH 8 (5mg/l Boron added to Feed water)

## Dimensions

All dimensions shown in Inches (millimeter).

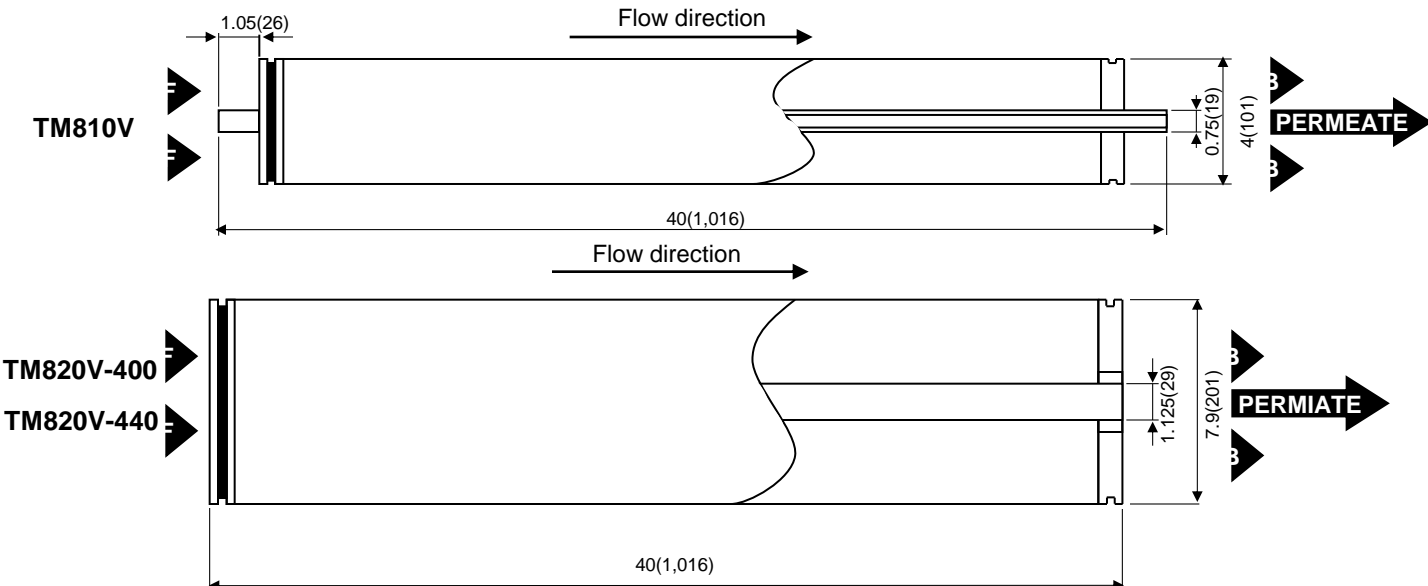

## Operating Limits

Maximum Operating Pressure	1200psi (8.3 MPa)
Maximum Feed Water Temperature	113° F (45°C)
Maximum Feed Water SDI15	5
Feed Water Chlorine Concentration	Not detectable
Feed Water pH Range, Continuous Operation	2-11
Feed Water pH Range, Chemical Cleaning	1-12
Maximum Pressure Drop per Element	15 psi (0.10 MPa)
Maximum Pressure Drop per Vessel	50 psi (0.34 MPa)

## Operating Information

1. For the recommended design range, please consult the latest Toray technical bulletin, design guidelines, computer design program, and/ or call an application specialist. If the operating limits given in this Product Information Bulletin are not strictly followed, the Limited Warranty will be null and void.
2. All elements are wet tested, treated with tested feed water solution, and then vacuum packed in oxygen barrier bags with deoxidant inside. To prevent biological growth during system shutdown, it is recommended to perform 30-60 minutes flushing of Toray elements with seawater once in every two days.
3. The presence of free chlorine and other oxidizing agents under certain conditions, such as heavy metals which acts as oxidation catalyst in the feed water will cause unexpected oxidation of the membrane. It is strongly recommended to remove these oxidizing agents contained in feed water before operating RO system.
4. Permeate from the first hour of operation shall be discarded.
5. The customer is fully responsible for the effects of chemicals that are incompatible with the elements. Their use will void the element Limited Warranty.

## Notice

1. Toray accepts no responsibility for results obtained by the application of this information or the safety or suitability of Toray's products, either alone or in combination with other products. Users are advised to make their own tests to determine the safety and suitability of each product combination for their own purposes.
2. All data may change without prior notice, due to technical modifications or production changes.

### **Asia and Oceania:** **Toray Industries, Inc.**

1-1, Nihonbashi  
muromachi 2-chome  
Chuo-ku, Tokyo 103-8666,  
Japan

Tel : +81 3 3245 4540  
Fax: +81 3 3245 4913  
<http://www.toraywater.com>

### **Americas:** **Toray Membrane USA, Inc.**

13435 Danielson St,  
Poway, CA 92064, USA  
Tel: +1 858 218 2390  
Fax: +1 858 486 3063

### **Europe:** **Toray Membrane Europe AG**

Grabenackerstrasse 8  
CH-4142 Münchenstein 1,  
Switzerland

Tel: +41 61 415 87 10  
Fax: +41 61 415 87 20

### **CHINA:** **Toray BlueStar Membrane Co., Ltd.**

No.5 Anxiang Street, Area B,  
Beijing Tianzhu Airport  
Economic Development Zone,  
Beijing ,101318 P.R.C.

Tel: +86 10 80490552  
Fax: +86 10 80485217

### **Middle East & North Africa:** **Toray Membrane Middle East LLC.**

PO Box 20279, Al Khobar 31952,  
Kingdom of Saudi Arabia

Phone: +966-13-568-0091  
Fax: +966-13-568-0093